



H112/00

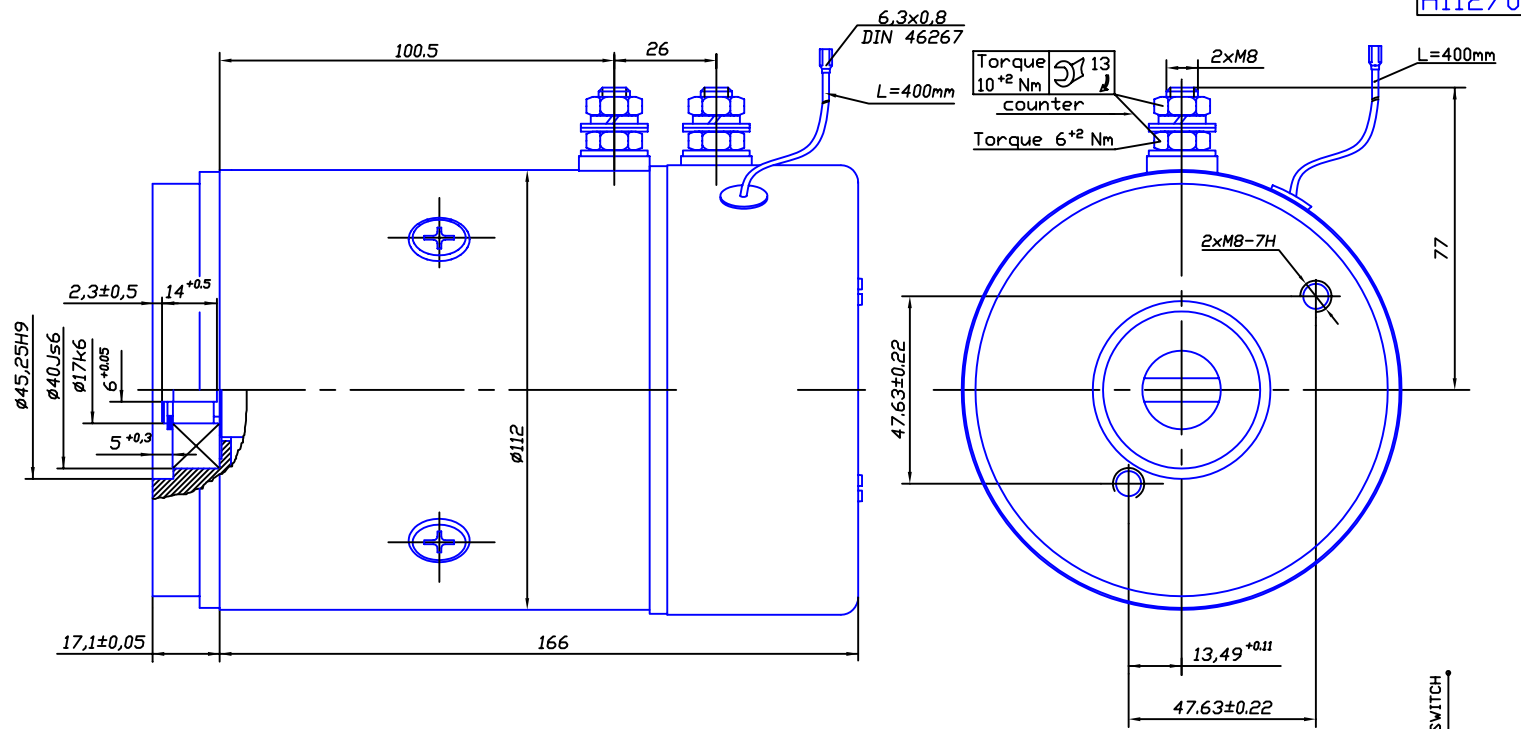

NOTE: The front side bearing fixing is ensured after the mounting of the pump. The other bearing is free.



CODE	V	kW	RPM	Rate	Rot	IP	Curve
MH112 1.5/27 1200	12	1,5	2700	S2-4min	CWDE	IP44	fig.1
MH112 2.0/23 1200	12	2,0	2300	S2-1,5min	CWDE	IP44	fig.1
MH112 1.5/27 2400	24	1,5	2700	S2-5min	CWDE	IP44	fig.2
MH112 2.0/23 2400	24	2,0	2300	S2-2min	CWDE	IP44	fig.2

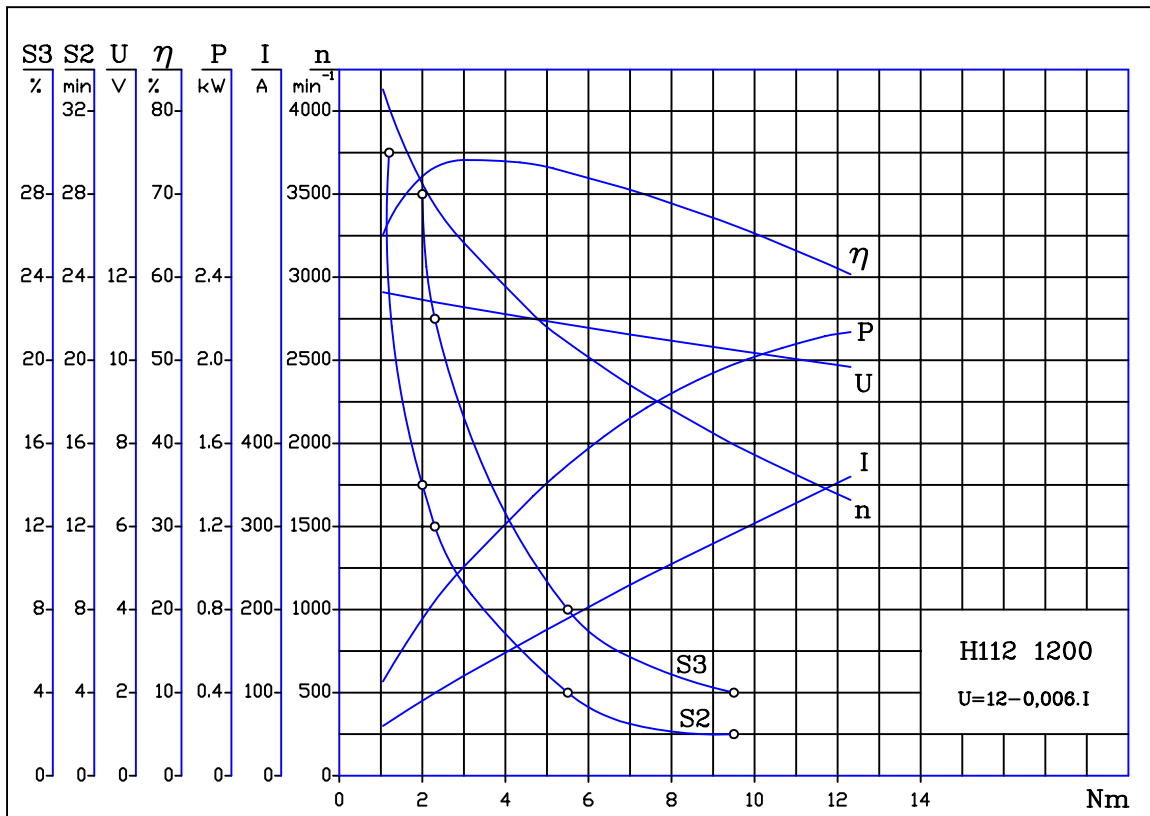


fig.1

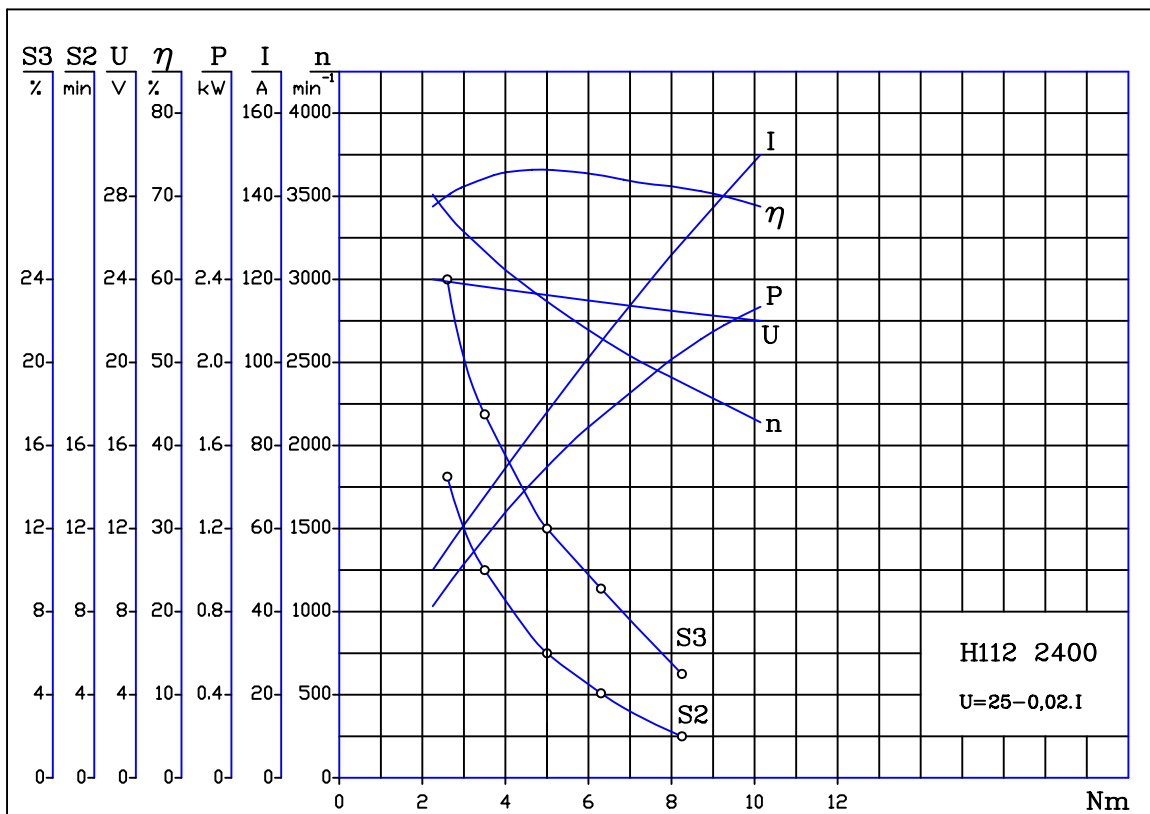


fig.2