


NOTE: The front side bearing fixing is ensured after the mounting of the pump. The other bearing is free.



CODE	V	kW	RPM	Rate	Rot	IP	Curve
------	---	----	-----	------	-----	----	-------

MH112 2.0/23 1204	12	2,0	2300	S2-3min	CWDE	IP20	fig.5
MH112 2.5/19 1204	12	2,5	1900	S2-1,5min	CWDE	IP20	fig.5
MH112 2.0/23 2404	24	2,0	2300	S2-5min	CWDE	IP20	fig.6
MH112 2.5/19 2404	24	2,0	1900	S2-1,5min	CWDE	IP20	fig.6

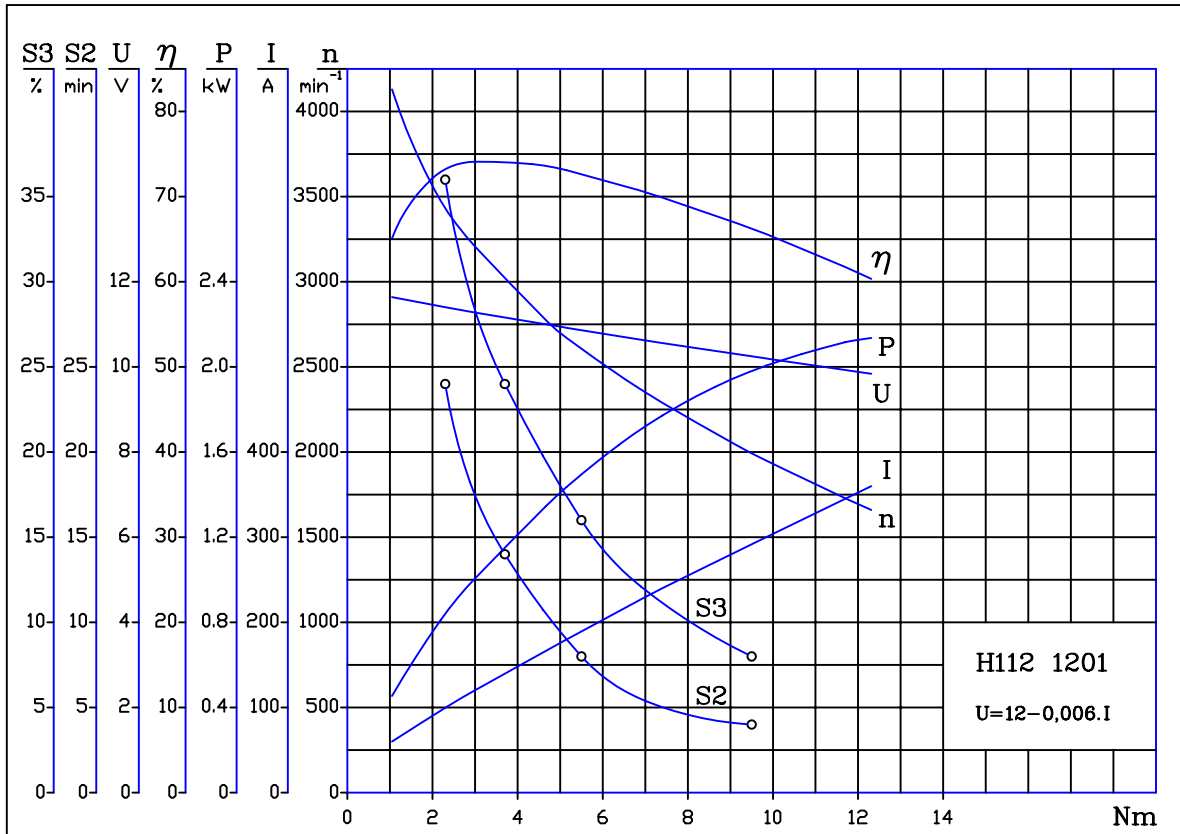


fig.5

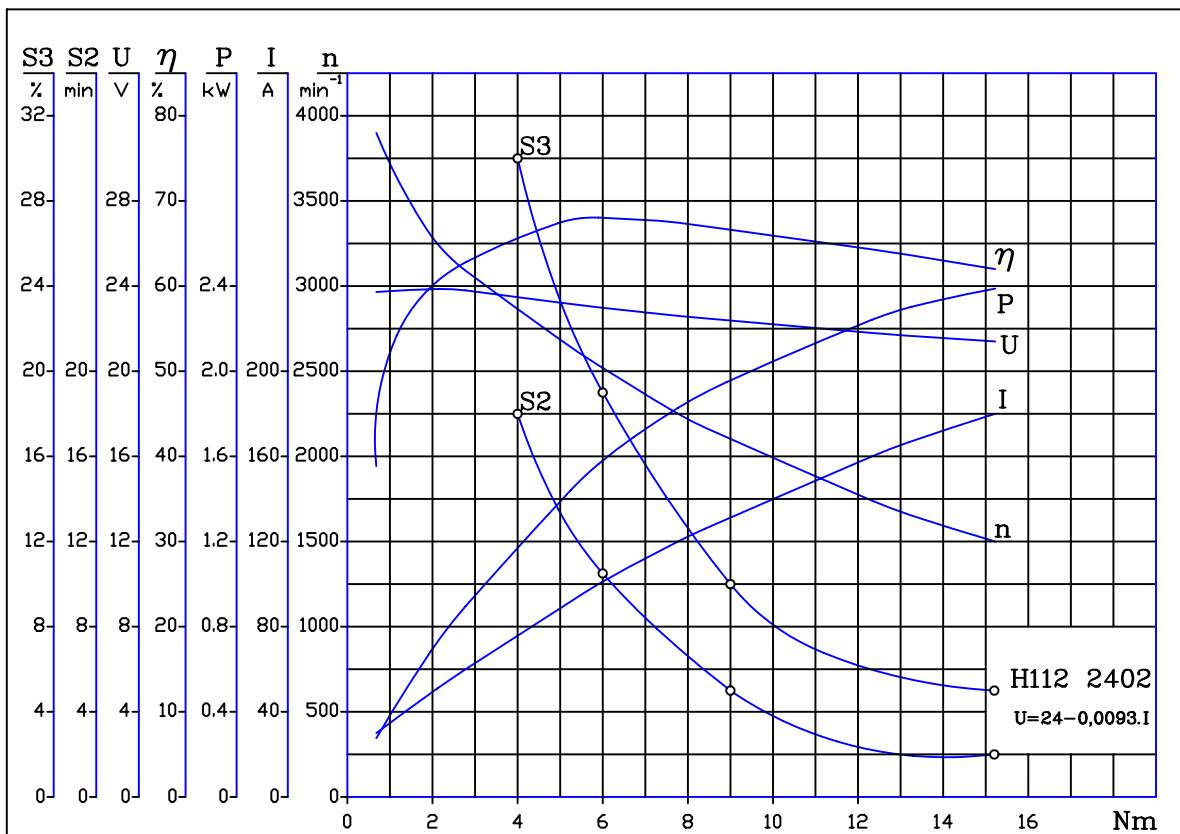


fig.6